

Product Name: DELTA

General Information

- This luminaire must be installed in accordance with the latest edition of the IET Wiring Regulations and local Building Regulation by a qualified competent person.
- The mains power supply must be turned off before inspection, installation or removal of the luminaire, ensuring that the supply is locked off to prevent inadvertently switching the supply on.
- It is the installer's responsibility to ensure that the installation is suitable for the total load of the luminaire(s). The supply cable fuses/circuit breakers must be correctly rated for the electrical load and taking into account for any transient inrush currents that may occur.
- It is the installer's responsibility to ensure that the environmental operating and storage conditions are complied with and that any fire risks are considered.
- Do not perform insulation strength or insulation resistance tests on the installation with the luminaire(s) connected, this can damage the luminaires and give erroneous readings.
- Do not loop-in supply cables at the luminaire supply terminals unless there is provision for 2-way connection at the terminals.
- The light source contained in this luminaire must only be replaced by TamLite Lighting or an appointed service agent.
- Emergency lighting luminaires must be installed and maintained in accordance with the emergency lighting standard BS 5266-1.
- To ensure that the product warranty remains valid, the luminaire must be installed and maintained in accordance with these installation instructions and the product must not be modified in any way.

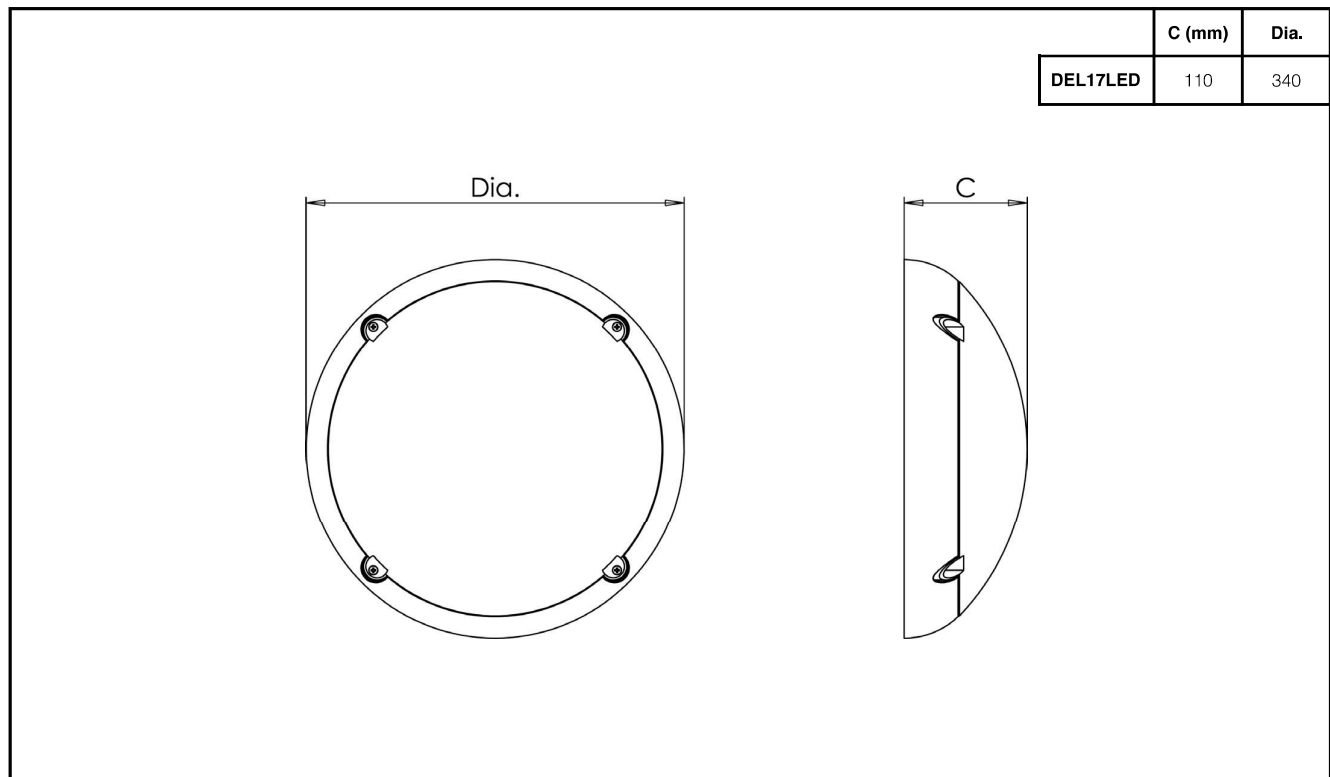


Luminaires marked with this symbol must not be covered with thermally insulating material.



This symbol on covers over light sources indicates dangerous live parts do not operate the luminaire with this cover removed.


Dimensions



Page 1 of 3

TamLite Technical
Stafford Park 12,
Telford, Shropshire,
TF3 3BJ



















+44(0)1952 292441
technical@tamlite.co.uk
Document No: V1



INSTALLATION & OPERATING INSTRUCTIONS



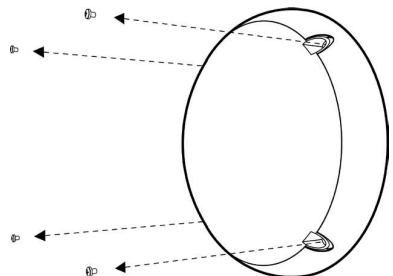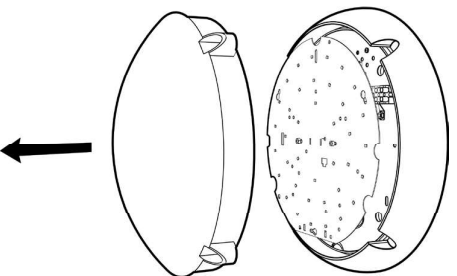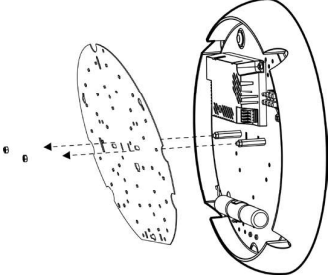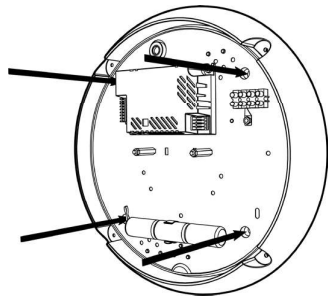





Product Name: DELTA

1  Remove the product from its packaging.	2  Remove the four screws to release the diffuser.					
3  Remove the diffuser.	4  Undo the two nuts to release the LED board.					
5  Mark the luminaire mounting points and attach to the mounting surface.	6  Bring incoming supply cable through the back of the luminaire body.					
7 <table border="0"> <tr> <td data-bbox="219 1407 349 1711">  L Earth N Live Earth Neutral </td> <td data-bbox="446 1407 625 1711">  L_{SW} Earth N L_{UN} Switched Live Earth Neutral Permanent Live </td> <td data-bbox="706 1407 836 1711">  D₁ D₂ Dali 1 Dali 2 </td> <td data-bbox="868 1407 1047 1711">  L_{SW} Earth N L_{UN} Switched Live Earth Neutral Permanent Live </td> <td data-bbox="1128 1407 1421 1711">  D₁ D₂ L Earth N Dali 1 Dali 2 Live Earth Neutral </td> </tr> </table> Terminations shown for standard and emergency variants. Terminations shown for DALI dimmable and DALI emergency variants.		 L Earth N Live Earth Neutral	 L_{SW} Earth N L_{UN} Switched Live Earth Neutral Permanent Live	 D₁ D₂ Dali 1 Dali 2	 L_{SW} Earth N L_{UN} Switched Live Earth Neutral Permanent Live	 D₁ D₂ L Earth N Dali 1 Dali 2 Live Earth Neutral
 L Earth N Live Earth Neutral	 L_{SW} Earth N L_{UN} Switched Live Earth Neutral Permanent Live	 D₁ D₂ Dali 1 Dali 2	 L_{SW} Earth N L_{UN} Switched Live Earth Neutral Permanent Live	 D₁ D₂ L Earth N Dali 1 Dali 2 Live Earth Neutral		

Page 2 of 3


Tamlite Technical
Stafford Park 12,
Telford, Shropshire,
TF3 3BJ

+44(0)1952 292441
technical@tamlite.co.uk
Document No: V1





Product Name: DELTA

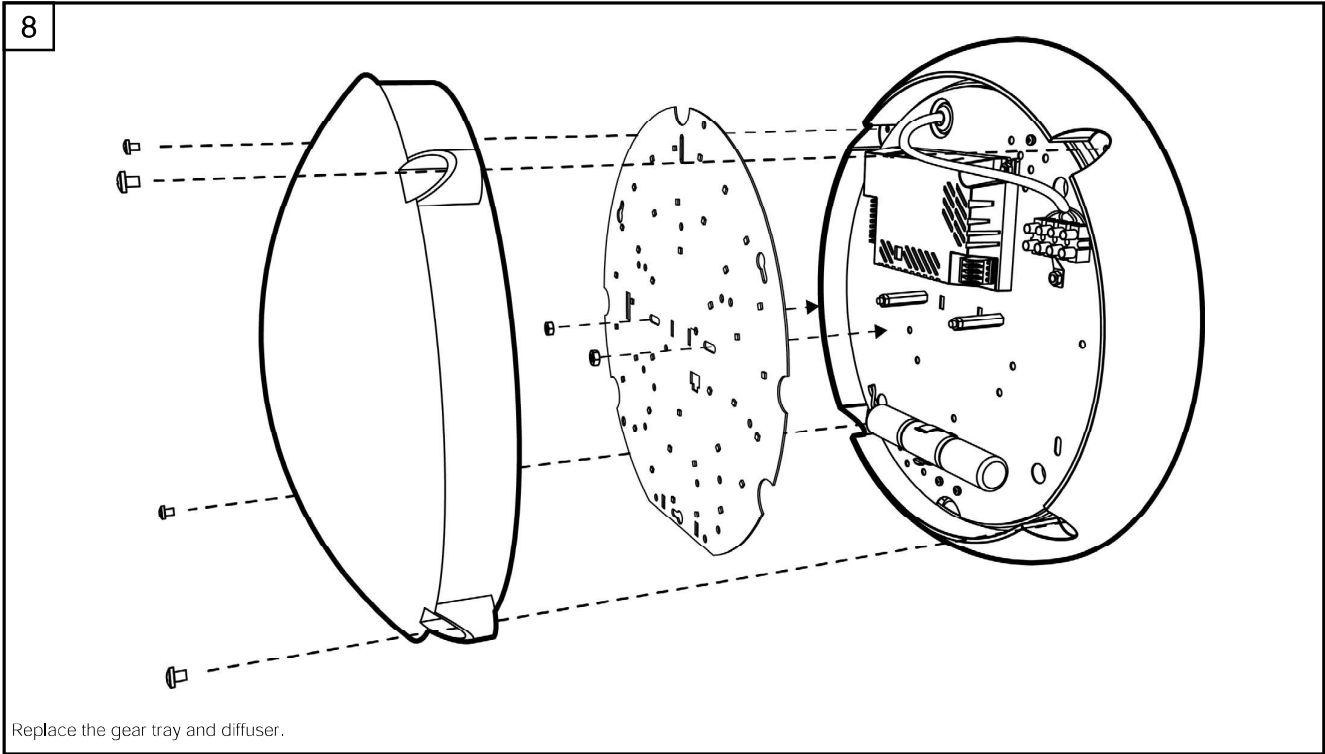

Page 3 of 3

Tamlite Technical
Stafford Park 12,
Telford, Shropshire,
TF3 3BJ

+44(0)1952 292441
technical@tamlite.co.uk
Document No: V1

		220-240V 50/60Hz		IP65	IK08	TP(a)	ta 0°C to 25°C 5°C to 25°C for M3 variants
--	--	---------------------	--	------	------	-------	---