

## Product Name: XCITE HIGH BAY MICROWAVE SENSOR

### General information

- This luminaire must be installed in accordance with the latest edition of the IET Wiring Regulations and local Building Regulation by a qualified competent person.
- The mains power supply must be turned off before inspection, installation or removal of the luminaire, ensuring that the supply is locked off to prevent inadvertently switching the supply on.
- It is the installer's responsibility to ensure that the installation is suitable for the total load of the luminaire(s). The supply cable fuses/circuit breakers must be correctly rated for the electrical load and taking into account for any transient inrush currents that may occur.
- It is the installer's responsibility to ensure that the environmental operating and storage conditions are complied with and that any fire risks are considered.
- Do not perform insulation strength or insulation resistance tests on the installation with the luminaire(s) connected, this can damage the luminaires and give erroneous readings.
- Do not loop-in supply cables at the luminaire supply terminals unless there is provision for 2-way connection at the terminals.
- The light source contained in this luminaire must only be replaced by TamLite Lighting or an appointed service agent.
- Emergency lighting luminaires must be installed and maintained in accordance with the emergency lighting standard BS 5266-1.
- To ensure that the product warranty remains valid, the luminaire must be installed and maintained in accordance with these installation instructions and the product must not be modified in any way.



Luminaires marked with this symbol must not be covered with thermally insulating material.

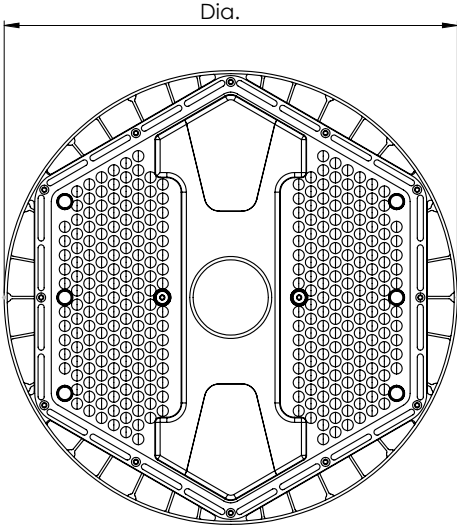
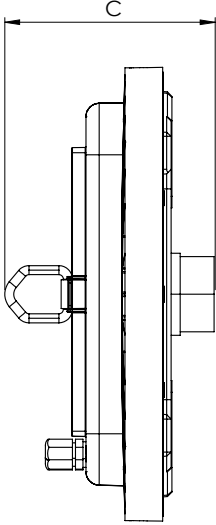


This symbol on covers over light sources indicates dangerous live parts do not operate the luminaire with this cover removed.

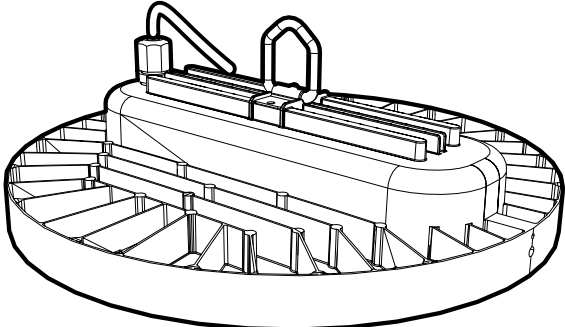
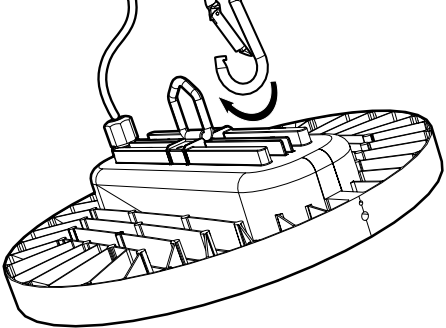
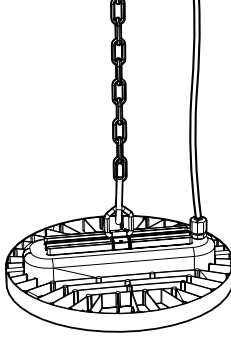
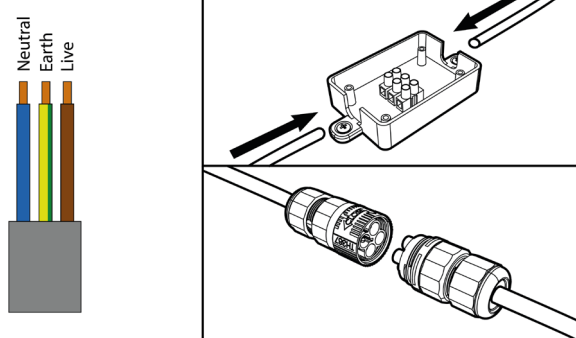
### Dimensions

	Dia. (mm)	C (mm)
XCHBA100NWMS	301	140
XCHBA150NWMS / XCHBA200NWMS	361	140

## Product Name: XCITE HIGH BAY MICROWAVE SENSOR

<p>1</p>  <p>Remove the product from its packaging.</p>	<p>2</p>  <p>Suspend the luminaire from the eyelet via a suitable suspension method.</p>																												
<p>3</p> 	<p>4</p>  <p>Connect supply cable to the pre-fitted power cord with a suitable rated connector.</p>																												
<p>5</p> <table border="1"> <thead> <tr> <th>MODE 1</th> <th>MODE 2</th> <th>MODE 3</th> <th>MODE 4</th> </tr> </thead> <tbody> <tr> <td>Brightness – <b>100%</b></td> <td>Brightness – <b>100%</b></td> <td>Brightness – <b>100%</b></td> <td>Brightness – <b>100%</b></td> </tr> <tr> <td>Sensitivity – <b>75%</b></td> <td>Sensitivity – <b>75%</b></td> <td>Sensitivity – <b>75%</b></td> <td>Sensitivity – <b>75%</b></td> </tr> <tr> <td>Hold time – <b>10s</b></td> <td>Hold time – <b>20m</b></td> <td>Hold time – <b>20m</b></td> <td>Hold time – <b>20m</b></td> </tr> <tr> <td>Daylight - <b>No</b></td> <td>Daylight - <b>No</b></td> <td>Daylight - <b>No</b></td> <td>Daylight - <b>No</b></td> </tr> <tr> <td>Stand By level - <b>0</b></td> <td>Stand By level - <b>0</b></td> <td>Stand By level - <b>10%</b></td> <td>Stand By level - <b>10%</b></td> </tr> <tr> <td>Stand by time - <b>Infinite</b></td> <td>Stand by time - <b>Infinite</b></td> <td>Stand by time - <b>30min</b></td> <td>Stand by time - <b>Infinite</b></td> </tr> </tbody> </table> <p>Select required mode using hand-held programmer, refer to separate instructions sheet for further information.</p>		MODE 1	MODE 2	MODE 3	MODE 4	Brightness – <b>100%</b>	Brightness – <b>100%</b>	Brightness – <b>100%</b>	Brightness – <b>100%</b>	Sensitivity – <b>75%</b>	Sensitivity – <b>75%</b>	Sensitivity – <b>75%</b>	Sensitivity – <b>75%</b>	Hold time – <b>10s</b>	Hold time – <b>20m</b>	Hold time – <b>20m</b>	Hold time – <b>20m</b>	Daylight - <b>No</b>	Daylight - <b>No</b>	Daylight - <b>No</b>	Daylight - <b>No</b>	Stand By level - <b>0</b>	Stand By level - <b>0</b>	Stand By level - <b>10%</b>	Stand By level - <b>10%</b>	Stand by time - <b>Infinite</b>	Stand by time - <b>Infinite</b>	Stand by time - <b>30min</b>	Stand by time - <b>Infinite</b>
MODE 1	MODE 2	MODE 3	MODE 4																										
Brightness – <b>100%</b>	Brightness – <b>100%</b>	Brightness – <b>100%</b>	Brightness – <b>100%</b>																										
Sensitivity – <b>75%</b>	Sensitivity – <b>75%</b>	Sensitivity – <b>75%</b>	Sensitivity – <b>75%</b>																										
Hold time – <b>10s</b>	Hold time – <b>20m</b>	Hold time – <b>20m</b>	Hold time – <b>20m</b>																										
Daylight - <b>No</b>	Daylight - <b>No</b>	Daylight - <b>No</b>	Daylight - <b>No</b>																										
Stand By level - <b>0</b>	Stand By level - <b>0</b>	Stand By level - <b>10%</b>	Stand By level - <b>10%</b>																										
Stand by time - <b>Infinite</b>	Stand by time - <b>Infinite</b>	Stand by time - <b>30min</b>	Stand by time - <b>Infinite</b>																										

## Page 2 of 2

Tamlite Technical  
Stafford Park 12,  
Telford, Shropshire,  
TF3 3BJ

+44(0)1952 292441  
technical@tamllite.co.uk  
Document No: V1

